



HYDRANT CONNECTION

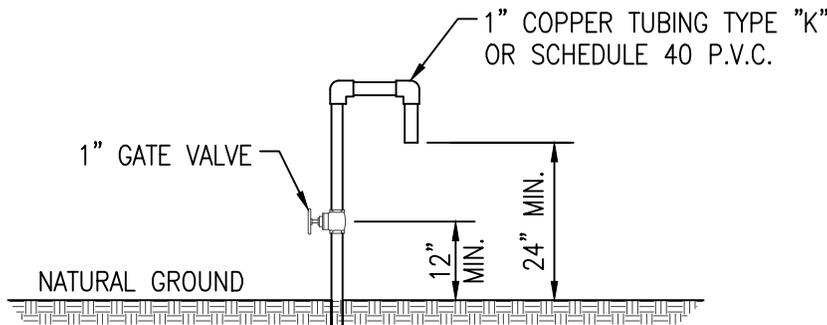

THE EXCAVATED HOLE FOR THIS INSTALLATION SHALL BE BACKFILLED TO NATURAL GRADE PRIOR TO DISCHARGING ANY WATER ON THE GROUND.

CORPORATION STOP – AFTER SAMPLING IS COMPLETE, CORPORATION STOP AND TUBING SHALL BE REMOVED. SADDLE SHALL BE PLUGGED WITH BRASS PLUG.

DOUBLE STRAP TAPPING SADDLE – AWWA THREADS AND NO DIRECT TAPS SHALL BE PERMITTED.

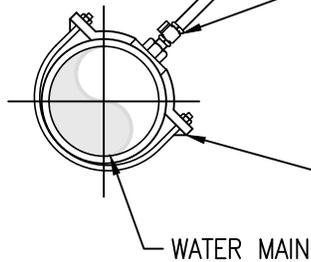

MAIN CONNECTION

NOTE:

1. SEE 2" TERMINAL BLOW-OFF ALSO.


CITY OF PEMBROKE PINES
ENGINEERING/UTILITIES DIVISION

STANDARD WATER
DISTRIBUTION DETAIL

APPROVED: J.M.
DATE: 11/05/99

REVISED:

TYPICAL SAMPLE POINTS



W-3