


SINGLE SERVICE PLAN

DOUBLE SERVICE PLAN

NOTE:

METER AND METER BOX TO BE SUPPLIED BY CITY AND INSTALLED BY CONTRACTOR.
 BACKFLOW PREVENTER SHALL BE INSTALLED DOWNSTREAM OF METER PER CODE.
 18" MIN SEPARATION SHALL BE MAINTAINED BETWEEN SERVICE SADDLES.

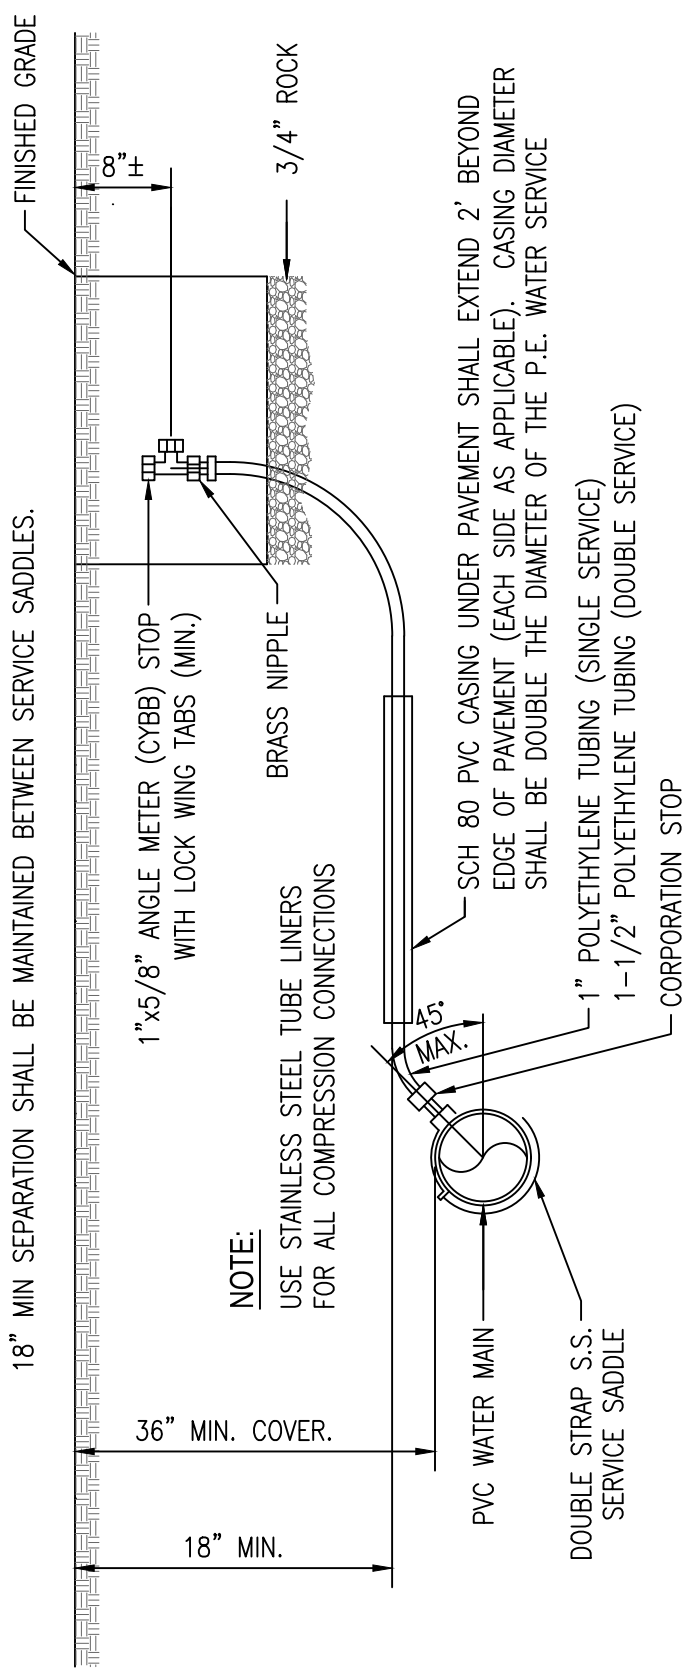

NOTE:

USE STAINLESS STEEL TUBE LINERS FOR ALL COMPRESSION CONNECTIONS

SCH 80 PVC CASING UNDER PAVEMENT SHALL EXTEND 2' BEYOND EDGE OF PAVEMENT (EACH SIDE AS APPLICABLE). CASING DIAMETER SHALL BE DOUBLE THE DIAMETER OF THE P.E. WATER SERVICE


CITY OF PEMBROKE PINES
 ENGINEERING/UTILITIES DIVISION

STANDARD WATER
 DISTRIBUTION DETAIL

APPROVED: J.M.
 DATE: 11/05/99

REVISED:
 07/17/19 | 06/13/22
 05/13/21 |
 06/01/22 |

TYPICAL SINGLE & DOUBLE
 SERVICE CONNECTION



W-4