



**SINGLE SERVICE PLAN**

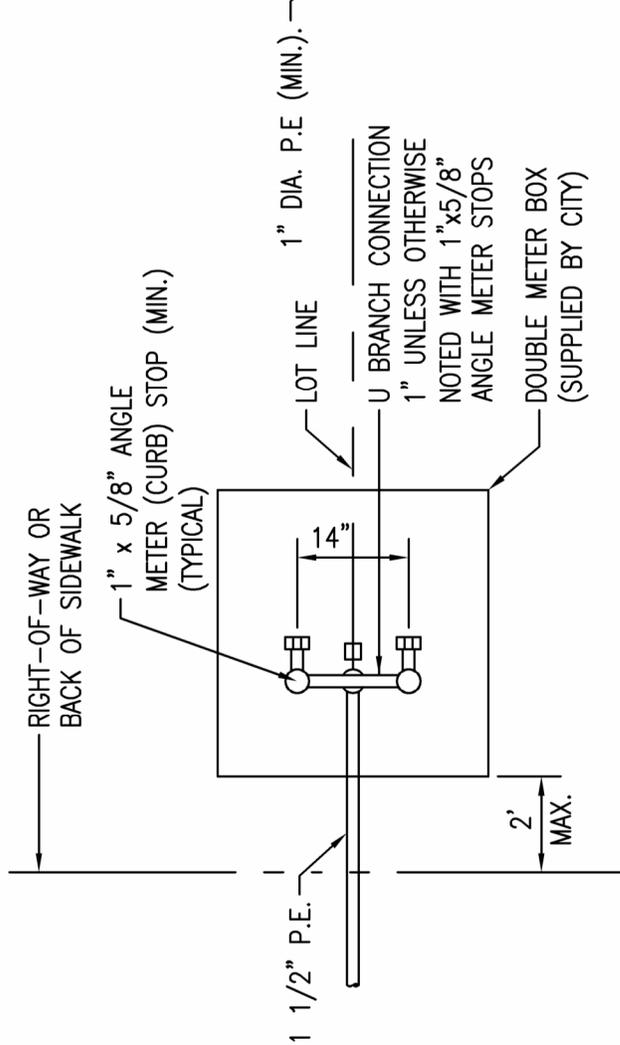

**DOUBLE SERVICE PLAN**

**NOTE:**

WATER METER BOX TO BE SUPPLIED BY CITY AND INSTALLED BY CONTRACTOR. WATER METER(S) TO BE INSTALLED BY CITY. 5/8" WATER METERS ARE SUPPLIED WITH BACKFLOW PREVENTERS. BACKFLOW PREVENTERS GREATER THAN 5/8" SHALL BE INSTALLED DOWNSTREAM OF METER PER CODE. 18" MIN SEPARATION SHALL BE MAINTAINED BETWEEN SERVICE SADDLES.

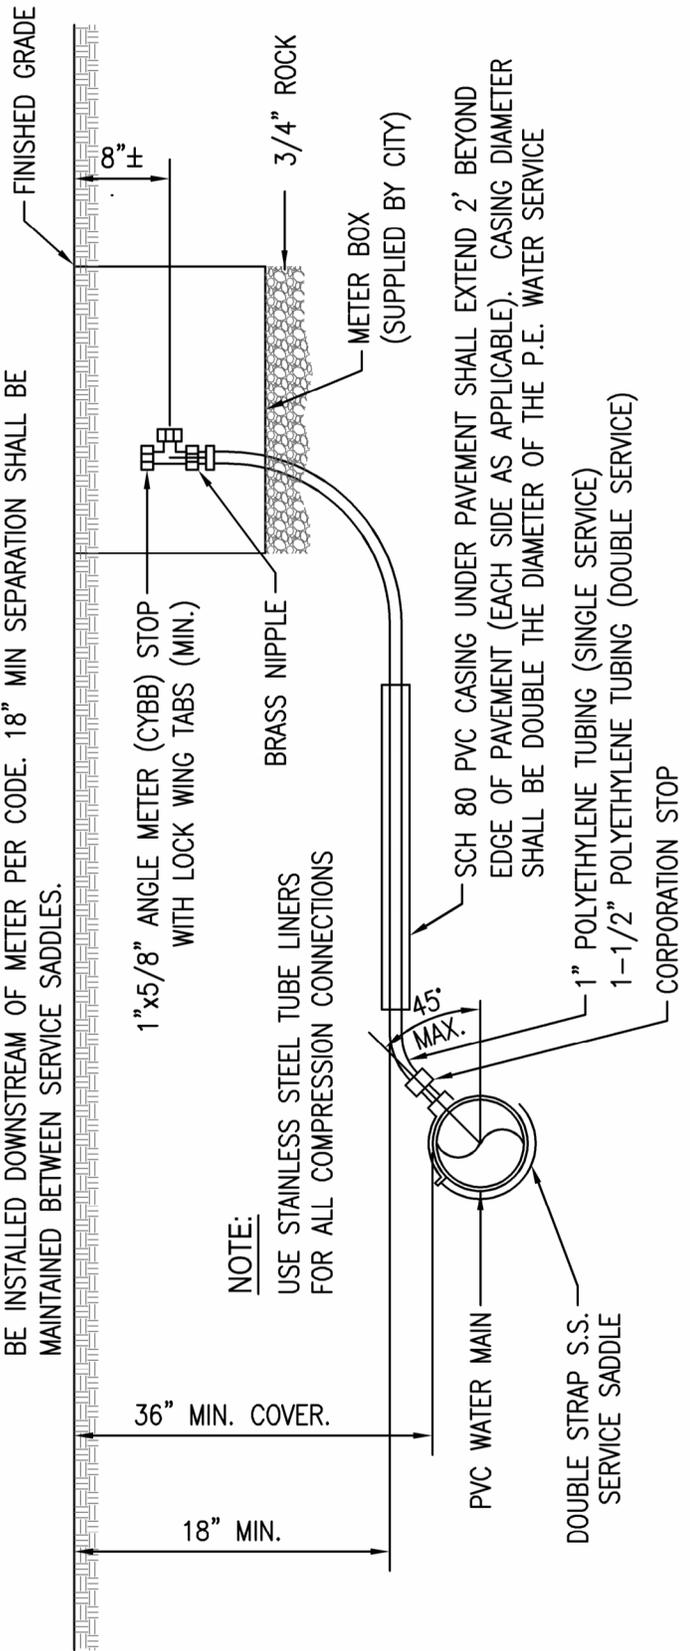

**NOTE:**

USE STAINLESS STEEL TUBE LINERS FOR ALL COMPRESSION CONNECTIONS

SCH 80 PVC CASING UNDER PAVEMENT SHALL EXTEND 2' BEYOND EDGE OF PAVEMENT (EACH SIDE AS APPLICABLE). CASING DIAMETER SHALL BE DOUBLE THE DIAMETER OF THE P.E. WATER SERVICE

1" POLYETHYLENE TUBING (SINGLE SERVICE)  
 1-1/2" POLYETHYLENE TUBING (DOUBLE SERVICE)  
 CORPORATION STOP


CITY OF PEMBROKE PINES  
 ENGINEERING/UTILITIES DIVISION

STANDARD WATER  
 DISTRIBUTION DETAIL

APPROVED: J.M.  
 DATE: 11/05/99

REVISED:  
 07/17/19 06/13/22  
 05/13/21 05/06/25  
 06/01/22

TYPICAL SINGLE & DOUBLE  
 SERVICE CONNECTION



**W-4**