


**FIRE LANES REQUIREMENTS FOR BUILDINGS**

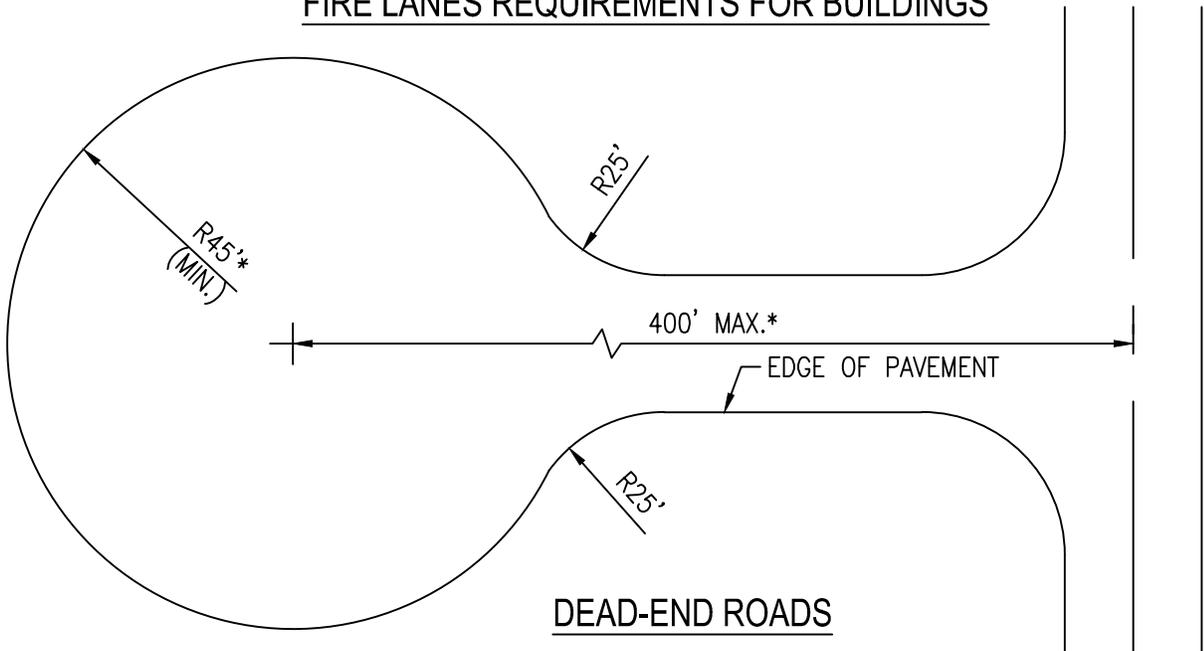

**DEAD-END ROADS**

\* 50' RADIUS REQUIRED IF CUL-DE-SAC IS MORE THAN 150' IN LENGTH


CITY OF PEMBROKE PINES  
ENGINEERING/UTILITIES DIVISION

STANDARD ROAD DETAIL

APPROVED: J.M.  
DATE: 11/05/99

REVISED:  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

FIRE LANES AND MIN. TURNAROUND  
REQUIRED AT DEAD-ENDS



**R-12**