


PLAN

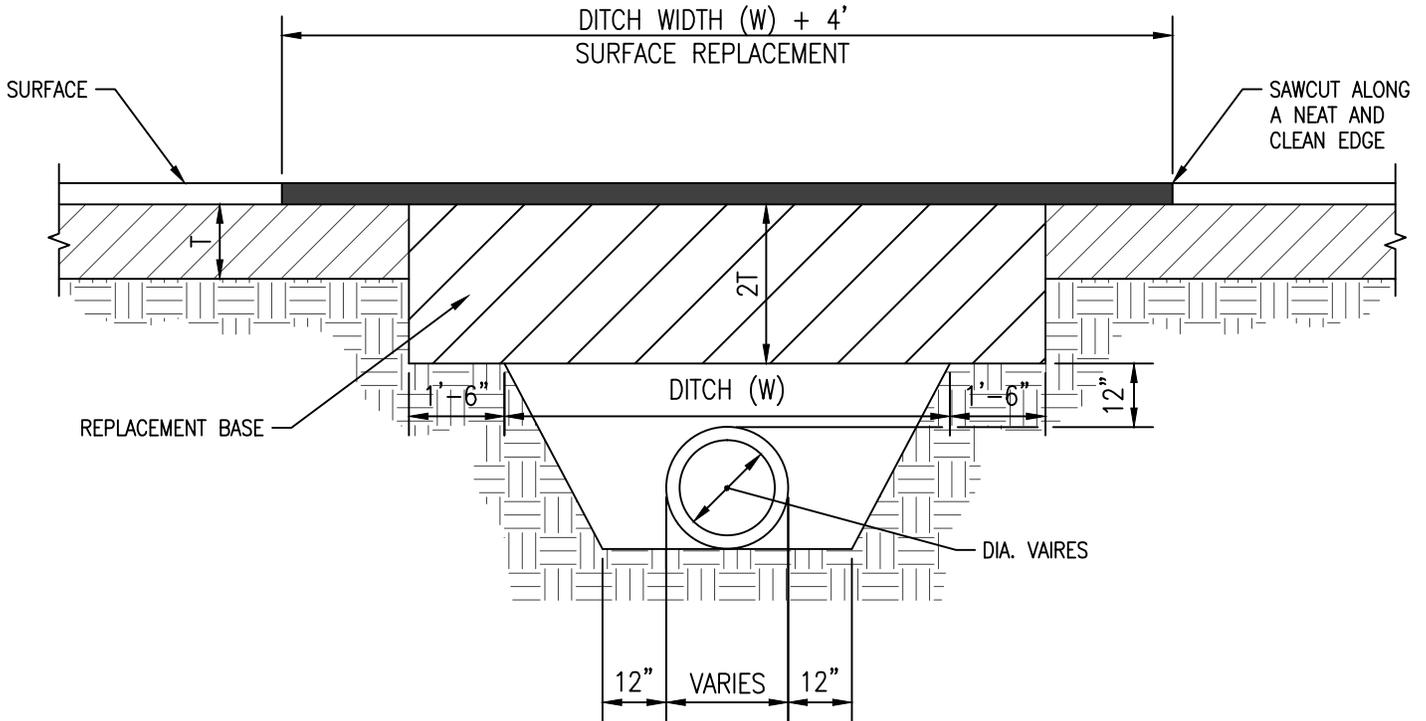

SECTION A-A

NOTES:

1. REPLACED BASE MATERIAL OVER DITCH SHALL BE TWICE THE THICKNESS OF THE ORIGINAL BASE. MINIMUM 8", MAXIMUM 18"
2. BASE MATERIAL SHALL BE PLACED IN 6" MAXIMUM (LOOSE MEASUREMENT) LAYERS AND EACH LAYER THOROUGHLY ROLLED OR TAMPED TO 98% OF MAXIMUM DENSITY. PER AASHTO T-180.
3. ASPHALT CONCRETE PAVEMENT JOINTS SHALL BE MECHANICALLY SAWED.
4. SURFACED TREATED PAVEMENT JOINTS SHALL BE LAPPED AND FEATHERED.
5. SURFACE MATERIAL WILL BE CONSISTENT WITH THE EXISTING SURFACE.
6. BASE MATERIAL SHALL HAVE A MINIMUM LBR. OF 100 AND A MINIMUM CARBONATE CONTENT OF 70% (60% FOR LOCAL STREETS).
7. IF THE DITCH IS FILLED TEMPORARILY. IT SHALL BE COVERED WITH A 2" ASPHALTIC CONCRETE PATCH TO KEEP THE FILL MATERIAL FROM RAVELING UNTIL REPLACED WITH A PERMANENT PATCH.
8. BACKFILL SHALL BE IN ACCORDANCE WITH DETAIL R- 33, EXCEPT AS SHOWN ABOVE.

RE: B.C.P.W.D. PLATE No.6

CITY OF PEMBROKE PINES
ENGINEERING/UTILITIES DIVISION


STANDARD ROAD DETAIL

APPROVED: J.M.

REVISED:

DATE: 11/05/99

FLEXIBLE PAVEMENT RESTORATION
PERPENDICULAR UTILITY
INSTALLATION



R-34